


ROOFTOP INSTALL GUIDE REFERENCE

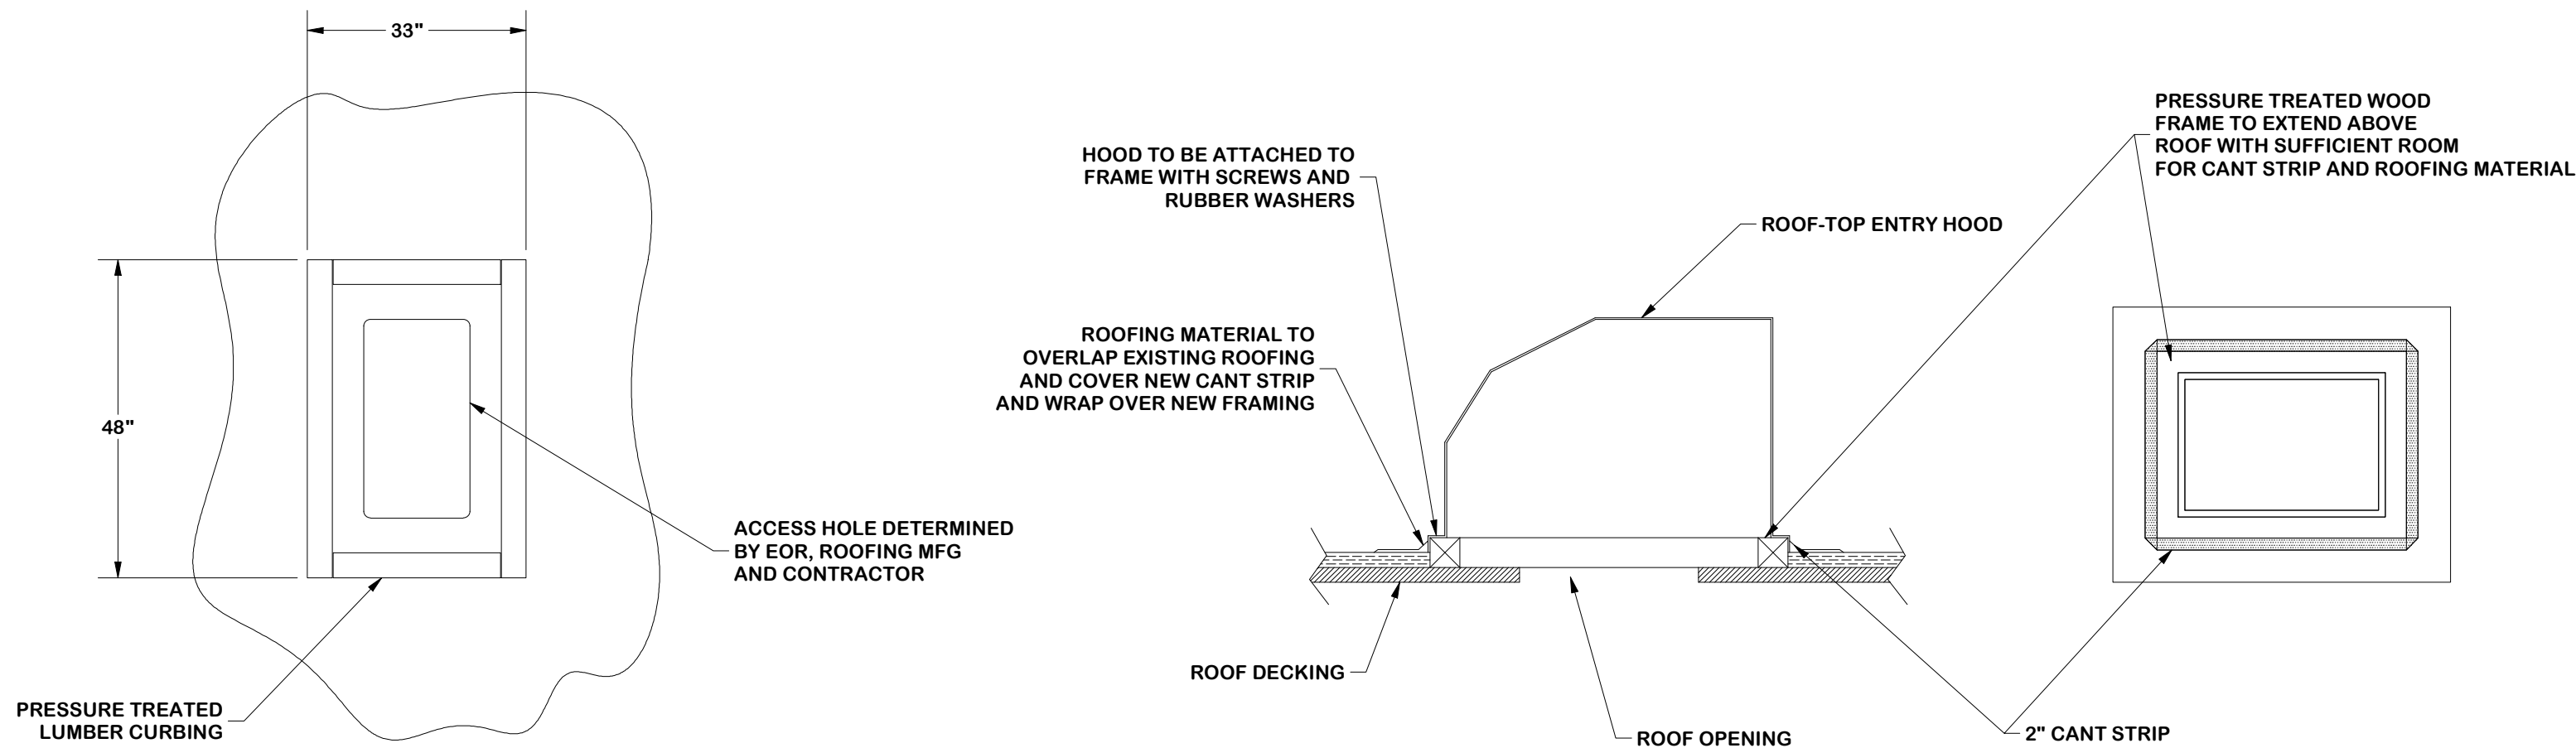

GENERAL RECOMENDATIONS

- USE PRESSURE-TREATED 4×4 OR 4×6 , 4X8 WOOD CURB FRAMING.
- MECHANICALLY ANCHOR THE CURB TO THE METAL ROOF DECK OR SUPPLEMENTAL FRAMING. DO NOT RELY ON ROOFING MASTIC / TAR AS THE PRIMARY MEANS OF ATTACHMENT.
- ROOFING MASTIC OR SEALANT MAY BE USED AS A BEDDING OR SEALING LAYER WHERE REQUIRED BY THE ROOFING MANUFACTURER.
- FULLY FLASH THE CURB INTO THE EXISTING ROOFING SYSTEM IN ACCORDANCE WITH THE ROOFING MANUFACTURER'S INSTALLATION REQUIREMENTS.
- MAINTAIN THE CURB HEIGHT ABOVE THE FINISHED ROOF SURFACE AS REQUIRED BY THE ROOFING MANUFACTURER AND PROJECT SPECIFICATIONS (COMMONLY 8 INCHES MIN.).
- THE TAPERED POLYISO INSULATION SHOULD TERMINATE TIGHTLY AROUND THE CURB BUT SHOULD NOT BE RELIED UPON TO SUPPORT THE HOOD DEAD LOAD OR RESIST WIND LOADS. THE STRUCTURAL LOAD PATH SHOULD TRANSFER THROUGH THE HOOD, INTO THE CURB, THROUGH THE ROOF DECK, AND INTO THE SUPPORTING STRUCTURAL FRAMING.

TOLERANCE NOTES

TOLERANCES ON DIMENSIONS, UNLESS OTHERWISE NOTED ARE:
SAWED, SHEARED AND GAS CUT EDGES ($\pm 0.030''$)
DRILLED AND GAS CUT HOLES ($\pm 0.030''$) - NO CONING OF HOLES
LASER CUT EDGES AND HOLES ($\pm 0.010''$) - NO CONING OF HOLES
BENDS AND ANGLES ARE $\pm 1/2$ DEGREE
ALL OTHER MACHINING ($\pm 0.030''$)
ALL OTHER ASSEMBLY ($\pm 0.060''$)

PATENT INFORMATION: WWW.SITEPRO1.COM/PATENTS

PROPRIETARY NOTE:
THE DATA AND TECHNIQUES CONTAINED IN THIS DRAWING ARE PROPRIETARY INFORMATION OF VALMONT INDUSTRIES AND CONSIDERED A TRADE SECRET. ANY USE OR DISCLOSURE WITHOUT THE CONSENT OF VALMONT INDUSTRIES IS STRICTLY PROHIBITED.

DESCRIPTION

ROOFTOP HOOD ENTRY
W/ SOLID PANEL

CPD NO.

SP1

DRAWN BY

KC8 2/13/2013

ENG. APPROVAL

8/7/2026

CLASS

87

SUB

02

DRAWING USAGE

CUSTOMER

CHECKED BY

JET

8/7/2026



Engineering
Support Team:
sp1engineering@valmont.com

PART NO.

SP365G Roof Mockup

DWG. NO.

SP365G